



City of Winston-Salem Fire Department

Office of the Fire Marshal
725 North Cherry Street
Winston-Salem, North Carolina 27102
(336) 773-7900 (Office) (336) 773-7974 (Fax)



The following is a report of conditions found during the fire prevention inspection required by G.S. 160A-411. Violations (if any) are listed in the body of this form and on attached pages.


02/01/22

Weaver Fertilizer Company

4440 N CHERRY St
WINSTON-SALEM, NC 27106

Inspection # 438202

Property # 6744 **Occupancy Type** Annual

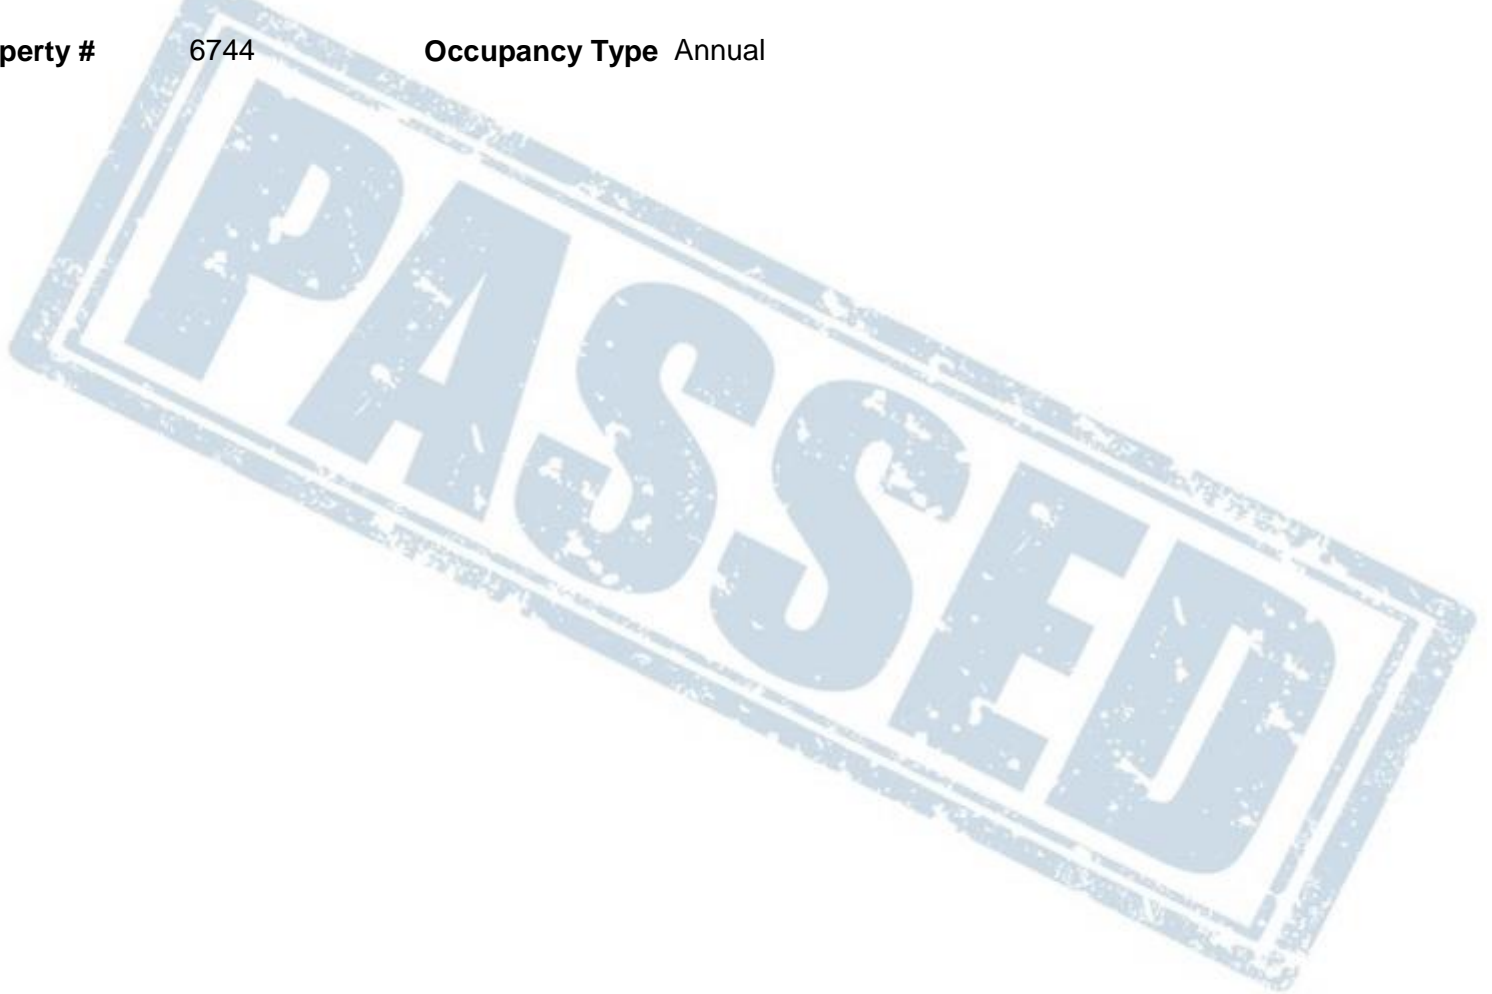

Contact:

Phone:

Email:

Inspection History

Inspection Date	Status	Inspected By
12/27/21	No Violations Found	Inspector BYRD

Inspection Remarks

2021 FIRE INSPECTION WITH: Tim parker

A fire safety inspection was conducted December 27, 2021 on the premise listed above. At the time of inspection, there were (0) hazards and/or violations noted.

RavenB@cityofwsfire.org

Additional notes:

- Parts of the building in poor condition
- Discussed extension cords being for temporary use only
- Un-mounted extinguisher corrected during inspection
- Address numbers fading, will need to be replaced soon



Inspector BYRD



Contact:

Phone:

Email: